

Using Particle Swarm Optimization Algorithm in the Distribution System Planning

¹Meysam Shamshiri, ¹Chin Kim Gan, ²Kamaruzaman Jusoff, ³Ihsan Jabbar Hasan, ¹Mohd Ruddin AbGhani and ⁴Mariana Yusoff

¹Faculty of Electrical Engineering, UniversitiTeknikal Malaysia Melaka (UTeM), Hang Tuah Jaya, 76100 Durian Tunggal, Melaka, Malaysia

²Perdana School of Science, Technology & Innovation Policy (UTM Perdana School), 6th Floor, Menara Razak, Universiti Teknologi Malaysia Kuala Lumpur, Jalan Semarak, 54100 Kuala Lumpur, Malaysia

³Foundation of Technical Education, Al-mansour, Baghdad, Iraq

⁴Centre for Languages and Human Development, UniversitiTeknikal Malaysia Melaka (UTeM), Hang Tuah Jaya, 76100 Durian Tunggal, Melaka, Malaysia

Abstract: Technology advancement, the drive to reduce environmental pollution and energy security concern, have led to an increase in the use of Distributed Generations (DGs). One of the important aspects of the power system is the optimal operation of distribution networks. Therefore, the objective of this paper is to determine the possible solution for optimal operation of distribution networks which takes into account the impact of DG. Since the optimal operation of distribution networks is an optimization problem with discrete and continuous variables, it can be introduced as an integer problem that can be formulated using the metaheuristic approach. This paper utilizes the Particle Swarm Optimization (PSO) algorithm to solve the distribution planning problem with DG. In addition, a case study on IEEE 34 bus system has been carried out to demonstrate the effectiveness of the PSO algorithm with regards to Genetic Algorithm (GA). Results indicate that PSO has better performance over the GA in terms of cost of losses minimization and convergence time. Future work should consider to minimize the overall network cost simultaneously that takes into account the DG investment cost, cost of losses and maintenance cost.

Key words: Distributed Generation, Distribution System Planning, Particle Swarm Optimization, Genetic Algorithm

INTRODUCTION

The electricity industry has faced major changes during the past decades. The desire to create a competitive environment has caused the separation of various entities such as generation, transmission and distribution. These developments and the other issues such as the climate change challenge, energy supply security and technology advancement have caused the increase in the utilization of DG. Most of DGs can be directly connected to the distribution network which is located close to the load centre. This issue offers a significant benefit to the system such as avoiding or deferring the need to install new transmission lines and reduce network power losses. Past research (Massoud Amin, S. and B.F. Wollenberg, 2005; Hobbs, B.F., 2001; Wilson, R.B., 1997) conducted under the Electric Power Research Institute (EPRI) have shown that more than 25% capacity of new installed DGs were installed until 2010.

With regards to the matter on DGs, thus there is a strong urge that the past system studies related to the system planning should be revisited.

One of the essential areas that need to be further explored is the optimal management of distribution networks (Chiradeja, P., 2005; Wang, Z. and Q. Xu., 2011). Generally, the optimal operation of distribution networks has led to an optimum use of resources within the prescribed network constraints (Danny Pudjianto, 2013; Chin Kim Gan, 2011). The optimization problem can be tackled in two conditions: firstly, the objective function has a minimum value; and secondly, the technical constraint of the problem should be met. The distribution network prior to DG connection was not involved with the distributed energy resources, thus the problem formulation of optimal management will only include the active power resources control that aims at reducing network losses (Ghadimi, A.A. and H. Rastegar, 2009; Wille-Hausmann, B., 2009).

The swarm intelligent algorithm is one of the evolutionary computation methods created to solve the optimization problems and since then, their ability to be used in optimization problems has been demonstrated (Kennedy, J. and R.C. Eberhart, 1997; Holland, J.H., 1992). In this method, the movement towards the optimal position is obtained from the best information of each particle which is included in the initial population (Best Personal Position) and the optimal position that is found by the neighbour's positions (Best Global Position).

Corresponding Author: Chin Kim Gan, Faculty of Electrical Engineering, UniversitiTeknikal Malaysia Melaka, Hang Tuah Jaya, 76100 Durian Tunggal, Melaka.

Tel: +6065552309 E-mail: ckgan@utem.edu.my

Initially, at the PSO algorithm, some particles are assumed in the intended search space as initial population. All points are based on Euclidean distance in a various categories. The instance, as illustrated in Figure 1, X_i consists of three factors tracer, namely based on Previous Position, Personal Best Position and Global Best Position. The function of each particle in the search space is calculated and each category determines the value of particle depending on the target function which is minimized or maximized. Thus, the best member of each category is determined. On the other hand, with regard to previous information of each particle, the best point can be identified, which is already discovered. Therefore, the optimal point of each category and particle is determined. The first recognition in each category corresponds to the global optimum and the second recognition corresponds to the personal or local optimum point. According to Figure 1, supported with the precedent paragraph, the particle can be moved in the direction of the following vector equation (Del Valle, Y., 2008):

$$V_i^{t+1} = (w * V_i^t) + \alpha(X^{Pbest} - X_i^t) + \beta(X^{Gbest} - X_i^t) \tag{1}$$

$$X_i^{t+1} = X_i^t + V_i^{t+1} \tag{2}$$

Where,

X_i^t Current position of Particle

X^{Pbest} Best personal position of Particle

X^{Gbest} Best global position of Particle

V_i^t Velocity of particle i towards previous vector

V_i^{t+1} Velocity of particle i towards next position

w Inertia weight factor

α & β Acceleration coefficient

OF Objective Function

$$X^{Pbest} = \begin{cases} X^{Pbest(j)} & \text{if } OF^{j+1} \geq OF^j \\ X_i^t & \text{if } OF^{j+1} \leq OF^j \end{cases} \tag{3}$$

$$X^{Gbest} = \begin{cases} X^{Gbest(j)} & \text{if } OF^{j+1} \geq OF^j \\ X^{Pbest(j+1)} & \text{if } OF^{j+1} \leq OF^j \end{cases} \tag{4}$$

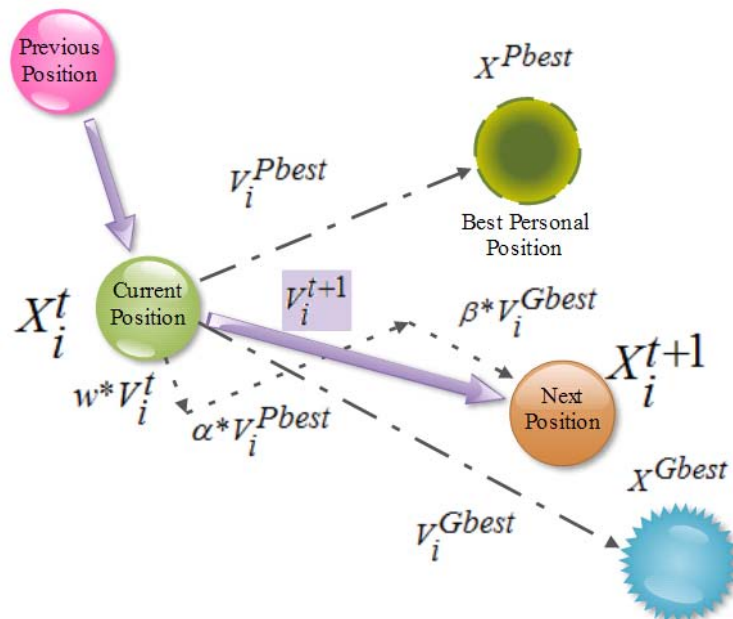


Fig. 1: Principle of the PSO particle movement.

The impacts of DGs on distribution network voltage drop need to be further investigated as it is one of the major constraints in objective function. Due to the small ratio of X to R in the distribution networks and the

radial structure of these grids, the impact of DGs on distribution network voltage is much higher than the other power reactive resources. For this purpose, the following two-bus networks and voltage drop equation for the network are calculated (Moradi, M.H. and M. Abedini, 2010) (Figure 2).

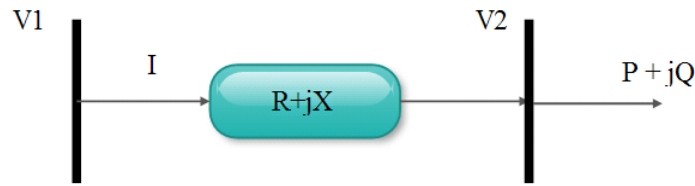


Fig. 2: Two-bus networks.

$$\Delta V = V_1 - V_2 = (R + jX)I \tag{5}$$

$$I = \frac{P-jQ}{V_2^*} \tag{6}$$

$$|\Delta V|^2 = \frac{(RP+XQ)^2+(RP-XQ)^2}{V_2^2} \approx \frac{(RP+XQ)^2}{V_2^2} \tag{7}$$

Where,

ΔV Line voltage drop

$R + jX$ Line impedance

Q Reactive power

P Active power

I Current flow through the line

$V_1 \& V_2$ Bus 1 and 2 voltage amplitude, respectively

As observed from the above equations, the voltage change affiliation to active power is not negligible because of the greater resistance value of distribution networks towards their reactance. Therefore, the optimization problem constraints are deemed necessary as these constraints are one of the penalty factors in the objective function.

The main target of distribution network planning is to minimize the objective function equation whereby the variables of this particular equation have a non-linear relation. Therefore, the objective function of the optimal operation problem is non-linear and discrete. In other words, the PSO algorithm is able to achieve the possible optimal global point with a sequence iteration and find the near optimal solution based on the related objective function. Pls re-write your objective in only 1 statement!!

Methods:

PSO Operation Procedure:

The PSO is a heuristic method based on creating an initial random solution as illustrated in Figure 3. There are six stages involved in the PSO flowchart, namely (a) Initialize Input data: The configuration of the distribution network and candidate DG sizing and locating are provided in this stage. The function model is produced by setting the random initial population and iteration number, random initial selection of position and velocity into the search space, (b) Calculate the objective function: The network solution program will be set up with the initial data whereby the objective function will calculate the summation of each particle, (c) Determine Pbest: The parameters of objective function values related to the positioning of each particle are compared with the corresponding value in previous positions. The lower objective function is then listed as Pbest for the current iteration as shown in the equation (3) (Ziari, I., 2009), (d) Determine Gbest: In this stage, the lowest objective function among the Pbests is related to all particles in the current iteration. It is then compared with the previous iteration and the lower one is recorded as the Gbest as shown in the equation (4) (Ziari, I., 2009), (e) Update velocity and position: The position and velocity of particles can be calculated for next iteration using both equations (1) and (2). It should be noted that α & β are acceleration coefficients that can be calculated as follows:

$$\alpha = C_1 r_1 \tag{8}$$

$$\beta = C_2 r_2 \tag{9}$$

Where, C_1 is the personal learning coefficient, C_2 is global learning coefficient and r_1 & $r_2 \sim U(0,1)$ are uniformly distributed random numbers and (f) Check stop condition: There are three different modes for finalization of the algorithm depending on the objective function for stopping the iteration loop as shown in Figure 4. The algorithm can be finalized 1) after achieving the satisfying cost and desired value of the objective function, or 2) after achieving the some stall iteration, which means after the specified time has elapsed or the number of iterations without any improvement in outcome, or 3) after the specified time has elapsed or number of state iterations. Hence, after calling each of the above cases, the algorithm will be finalized and the results will be printed in the output.

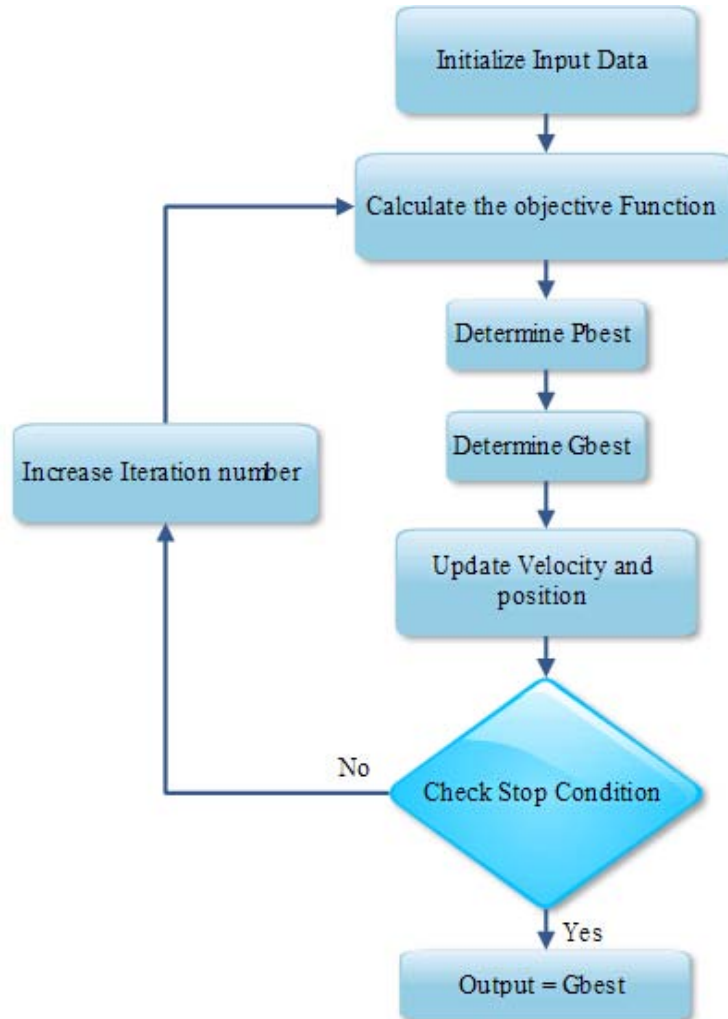


Fig. 3: The PSO algorithm flowchart.

Objective Function Formulation:

The allocating and sizing of the DG resources has seriously impacted on the system losses in the distribution networks. Therefore, the following objective function in the equation (12) will minimize the power losses and improve voltage profiling in the radial distribution network (Najafi, S., 2009; Niknam, T., 2005). The objective function and problem formulation as well as constraints are formulated as follows:

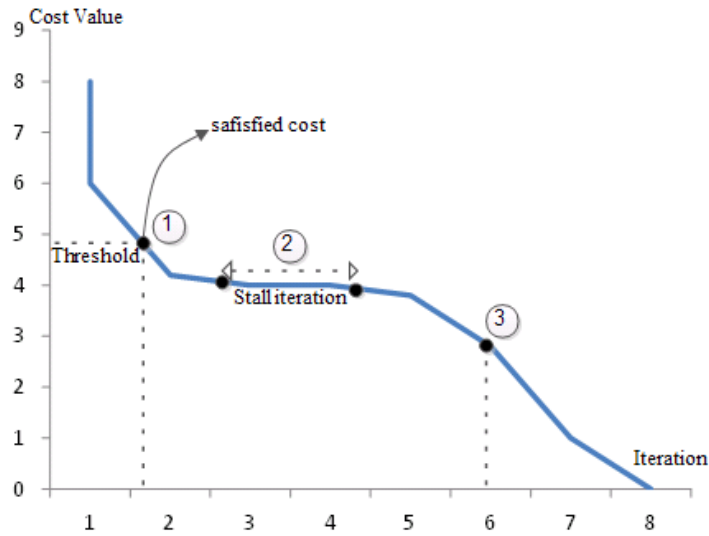


Fig. 4: Stop Conditions.

The following equation is represented power losses:

$$L_{realpower} = \sum_{i=2}^n (APO_i - APD_i - (Vs_i * Vr_i * Ysr_i * \cos(\delta r_i - \delta s_i + \theta y_i))) \quad (10)$$

Where,

- $L_{realpower}$ Real Power Losses
- APO_i Active power from output bus i
- APD_i Active power on demand bus i
- Vs_i Voltage from sending bus i
- Vr_i Volatge on receiving bus i
- Ysr_i Admittance between sending and receiving at bus i
- δs_i Phase angle of sending bus i
- δr_i Phase angle of receiving bus i
- θy_i Phase angle of $Y_{i < \theta_i}$

The following equation is represented to improve the voltage profile:

$$V_P = \sum_{i=1}^n (Vr_i - V_{rate})^2 \quad (11)$$

Where, V_P is voltage profile of objective function and V_{rate} is rated voltage. Thus, from equations (10) and (11), they represent the objective function in Equation (12) which must be minimized.

$$Z = \text{Min} [(L_{realpower} + \gamma * V_P) + DP] \quad (12)$$

Where, γ is violation coefficient, DP is the penalty factor that derived from problem constraints and Z is the cost function that should be minimized with PSO algorithm.

The problem constraints and limitation of optimal management distribution system planning are as follows:

- Bus voltage $V_i^{min} \leq V_i^t \leq V_i^{max}$
- Current feeders $I_{fi} \leq I_{fi}^{rated}$
- Reactive power of capacitors $Q_{ci}^{min} \leq Q_{gi}^t \leq Q_{ci}^{max}$
- Maximum power line transaction $|P_{ij}^{line}|^t \leq P_{ij}^{line max}$

RESULTS AND DISCUSSION

The distribution system planning is solved based on the results of the PSO algorithm and the GA application. The IEEE 34 buses that has been used in this study is as shown in Figure 5 with three different types of DG installed at the respective buses. The number of buses connected with DG and the DG characteristics are as listed in Table 1. The comparison between the results of PSO and GA after solving the objective function is shown in Table 2.

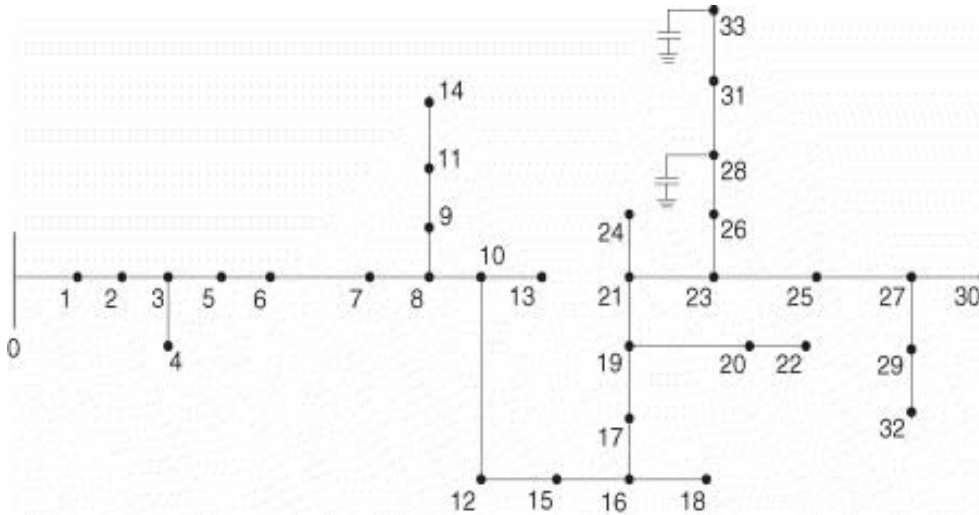


Fig. 5: IEEE 34 buses diagram.

Table 1: Distributed Generation features.

	G1	G2	G3
Active power (kW)	100	400	600
Max reactive power (kVar)	80	320	480
Min reactive power (kVar)	-60	-240	-360
Position in buses	5	15	33
Type of DG	Micro-turbine with CHP	Wind Turbine	Gas Turbine with CHP

Table 2: Comparison between GA and PSO.

Solution	Convergence time(Sec)		Objective function	
	Best	Worst	Best	Worst
GA	1200	1300	1026.46	1268.24
PSO	450	600	1020.43	1270.56

Figures 6 and 7 show the GA and PSO respectively from the Matlab program output after solving the optimization problems. Both figures indicate the convergence time after the number of iterations to reach to the satisfied cost function.

Fig. shows the GA algorithm is obtained to the best result after passing around 639 iterations but

Fig. shows the best result is achieved after 373 iterations. The convergence time for each method is shown in Table 1: Distributed Generation features.

	G1	G2	G3
Active power (kW)	100	400	600
Max reactive power (kVar)	80	320	480
Min reactive power (kVar)	-60	-240	-360
Position in buses	5	15	33
Type of DG	Micro-turbine with CHP	Wind Turbine	Gas Turbine with CHP

which pointed out the PSO algorithm could gain the better result in a superior way than GA.

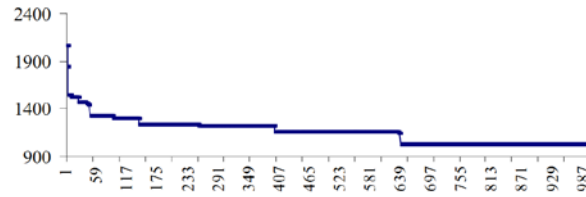


Fig. 6: Minimize the cost according to the number of iterations in GA.

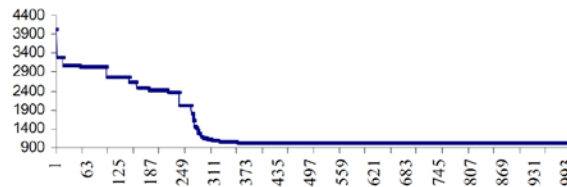


Fig. 7: Minimize the cost according to the number of iterations in PSO.

Conclusion:

Technology advancement has helped to facilitate the effective integration of DGs, which is commonly connected to the distribution networks. Moreover, this paper compares the performance of PSO and GA algorithm in terms of cost of losses minimization and convergence time. The presented study suggests that PSO solution is less time intensive if compared to GA method for cost of losses minimization problem in multi-DG system. The future work should consider to minimize the overall network cost simultaneously that takes into account the DG investment cost, cost of losses and maintenance cost.

ACKNOWLEDGMENT

The authors would like to gratefully acknowledge the funding support provided by the Ministry of Higher Education Malaysia under the research grant NO.MTUN /2012/UTEM-FKE/7 M00015.

REFERENCES

Chin Kim Gan, Pierluigi Mancarella, Danny Pudjianto, Goran Strbac, 2011. Statistical appraisal of economic design strategies of LV distribution networks. *Electric Power Systems Research*, 81(7): 1363-1372.

Chiradeja, P., 2005. Benefit of Distributed Generation: A Line Loss Reduction Analysis, in *Transmission and Distribution Conference and Exhibition, IEEE/PES, Asia and Pacific*, pp:1-5.

Danny Pudjianto, Predrag Djapic, Marko Aunedi, Chin Kim Gan, Goran Strbac, Sikai Huang, David Infield, 2013. Smart control for minimizing distribution network reinforcement cost due to electrification. *Energy Policy*, 52: 76-84.

Del Valle, Y., G.K. Venayagamoorthy, S. Mohagheghi, J.C. Hernandez and R.G. Harley, 2008. Particle swarm optimization: basic concepts, variants and applications in power systems. *IEEE Transactions on Evolutionary Computation*, 12(2): 171-195.

Ghadimi, A.A. and H. Rastegar, 2009. Optimal control and management of distributed generation units in an islanded MicroGrid, in *Integration of Wide-Scale Renewable Resources Into the Power Delivery System, CIGRE/IEEE PES*, pp: 1-7.

Hobbs, B.F., M.H. Rothkopf, R.P. O'Neill and H.P. Chao, 2001. *The next generation of electric power unit commitment models*. Norwell, USA, Springer Press, 328 p.

Holland, J.H., 1992. *Adaptation in natural and artificial systems: an introductory analysis with applications to biology, control, and artificial intelligence*. University of Michigan, USA, MIT Press, 211 p.

Kennedy, J. and R.C. Eberhart, 1997. A discrete binary version of the particle swarm algorithm. *Computational Cybernetics and Simulation, IEEE International Conference on Systems, Man, and Cybernetics - SMC*, 5: 4104-4108.

Massoud Amin, S. and B.F. Wollenberg, 2005. Toward a smart grid: power delivery for the 21st century. *IEEE Power and Energy Magazine*, 3(5): 34-41.

Moradi, M.H. and M. Abedini, 2010. A combination of genetic algorithm and particle swarm optimization for optimal DG location and sizing in distribution systems. *IPEC, 2010 Conference Proceedings*, pp: 858-862.

Najafi, S., S.H. Hosseinian, M. Abedi, A. Vahidnia and S. Abachezadeh, 2009. A framework for optimal planning in large distribution networks. *IEEE Transactions on Power Systems*, 24(2): 1019-1028.

Niknam, T., A.M. Ranjbar, A.R. Shirani, B. Mozafari and A. Ostadi, 2005. Optimal operation of distribution system with regard to distributed generation: a comparison of evolutionary methods in Industry Applications Conference. 4th IAS Annual Meeting Conference Record of the 2005, pp: 2690-2697.

Wang, Z. and Q. Xu., 2011. On distribution system planning method for reliability and its application. 4th International Conference on IEEE Electric Utility Deregulation and Restructuring and Power Technologies, pp: 1727-1731.

Wille-Haussmann, B., C. Wittwer and S. Tenbohlen, 2009. Reduced models for operation management of distributed generation, in Electricity Distribution - Part 1. 20th International Conference and Exhibition on CIRED, pp: 1-4.

Wilson, R.B., 1997. Nonlinear Pricing: Published in association with the Electric Power Research Institute. Oxford University Press, New York, USA. 430 p.

Ziari, I., G. Ledwich, M. Wishart, A. Ghosh and M. Dewadasa, 2009. Optimal allocation of a cross-connection and sectionalizers in distribution systems, in TENCON 2009 - IEEE Region 10 Conference, pp: 1-5.