

LEAKAGE CURRENT ANALYSIS OF POLYMERIC INSULATION USING LINEAR TIME FREQUENCY DISTRIBUTION

N.Norddin^{1*}, A. R. Abdullah², N. Q. Zainal Abidin³ and A. Aman⁴

^{1,2,3,4} Universiti Teknikal Malaysia Melaka (UTeM)/Faculty of Electrical Engineering, Malacca, Malaysia. ¹Email: m011110005@student.utm.edu.my, ²Email: abdulr@utm.edu.my, ³Email: nurqamarinaza@gmail.com, ⁴Email: aminudin@utm.edu.my

Abstract—Erosion on polymeric insulator surface caused by pollution affects their performance, until now there are no specific methods to determine their service life. Surface condition and their pollution severity of an insulator can be monitor by using leakage current frequency components. This paper presents time frequency distributions (TFD) for leakage current of polymeric insulation for high voltage applications. Tracking and erosion test (Inclined Plane Test (IPT)) complying with BS EN60587-2007 is conducted on polymeric insulation to collect different leakage current patterns. Since fast Fourier transforms (FFT) has limitation to analyze non stationary signal, thus time frequency distributions (TFD) shown in time frequency representation (TFR) with temporal and spectral is used. The verification using both methods on several disturbances signal with known parameters have been made and mean absolute percentage error (MAPE) used to identify the accuracy of both methods. The parameters measured are root mean square (RMS), total harmonic distortion (THD), total non harmonic distortion (TnHD) and total waveform distortion (TWD) used to determine the best method to analyze leakage current. The comparison shows that s-transform method is offer higher accuracy than spectrogram because it has better time and frequency resolution.

Keywords—Time frequency analysis; Spectrogram; S-transform

I. INTRODUCTION

Polymeric insulation has been widely accepted all over the world. They have greater properties than ceramic insulator in term of weight, hydrophobicity and dielectric strength. However, the life performance of polymeric insulator still unknown due to insufficient physical resistance and chemical degradation on its surface [1]. Surface condition of polymeric insulation material and their pollution severity can be determined by frequency component of leakage current. Time frequency distribution (TFD) used as a method for varieties of applications such as power quality because it is appropriate for examining non stationary signals as can be seen in [2-5].

Most previous works use fast Fourier transform (FFT) to analyze the leakage current signal. However, it does not provide temporal information and is not appropriate for non stationary signal. Real signal hold not only fundamental frequency, 50 Hz but also contains harmonics and inter-harmonic components [6]. The analysis using time frequency distribution (TFD) such as spectrogram and s-transform can be used to identify the harmonic and inter-harmonic components. As stated in [7, 8], the weakness of spectrogram is it has fixed

resolution so it does not track the signal dynamics properly. The pattern of the leakage current has been stated in [9-11]. The extracted information from both methods which is root mean square (RMS), total harmonic distortion (THD), total non harmonic distortion (TnHD) and total waveform distortion (TWD) need to be considered when analyzing the signal because the content of total frequency could have strong influence into signal and can be use to determine the severity of the surface condition [12].

Incline Plane Test (IPT) that complying with BS EN 60578-2007 was conducted on Polypropylene polymeric composite to simulate a set of different LC patterns from capacitive, resistive or hydrophilic state and local arcing event. This research focused on time-frequency analysis techniques to analyze leakage current patterns. Spectrogram and s-transform are proposed and signal parameters are extracted based on their time-frequency characteristics. The performance of both algorithms are analyzed and compared to perform leakage current classification.

II. EXPERIMENTAL WORK

Incline plane test (IPT) is normally used to evaluate the tracking and erosion resistance of insulating materials. It is a valuable tool for the comparison and evaluation of new and different materials under controlled electrical stress, to compare the suitability of materials for the dielectric surface of an insulator. It also has simplicity in test procedure and low equipment cost. IPT complies with BS EN 60587, and Polypropylene is used as the material under test. Fig. 1 shows the schematic circuit diagram for Inclined Plane Test. LABVIEW program is developed for LC data monitoring and storage for analysis purpose. In this study, Method 2 ‘variable voltage method’ or stepwise tracking voltage is applied to simulate the initial and continuous tracking voltage as well as surface condition events for sample specimen.

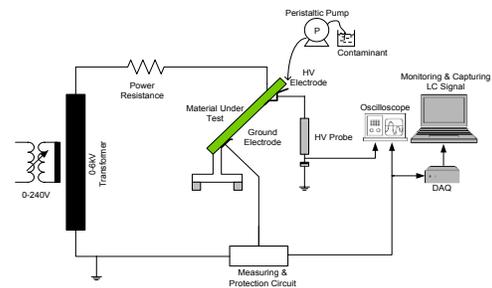


Figure 1. Inclined plane test (IPT)

III. TIME-FREQUENCY ANALYSIS TECHNIQUES

In this section, there are two types of linear time frequency analysis techniques are presented. They are spectrogram and s-transform.

A. Spectrogram

Spectrogram is one of the time-frequency representations (TFR) that represents a three-dimensional of the signal energy with respect to time and frequency. Spectrogram is the squared magnitude of the STFT. This technique roughly reflects how frequency content changes over time. Smaller window size used produces better time resolution but it also reduces frequency resolution. This is cause by window effect.

$$S_x(t, f) = \left| \int_{-\infty}^{\infty} h(\tau) w(\tau - t) e^{-j2\pi f \tau} d\tau \right|^2 \quad (1)$$

Where $h(\tau)$ is the input signal and $w(t)$ is the window observation window. In this study, Hanning window is selected because of its lower peak side lobe [10] which is narrow effect on other frequencies around fundamental value (50 Hz in this study) and other frequency components.

B. S-transform

S-transform is proposed by Stockwell [13] which time frequency spectral localization method that combine element of Wavelet transform and short time Fourier transform (STFT). S-transform employs a moving and scalable localizing Gaussian window and the equation of Gaussian window shown in (3). It combines a frequency dependent resolution with simultaneous localizing the real and imaginary spectra. The basis functions for the s-transform are Gaussian modulated cosinusoids whose width varies inversely with the frequency. S-transform, introduced by Stockwell et al. (1996) is defined by the general equation (2):

$$ST(\tau, f) = \int_{-\infty}^{\infty} h(t) \frac{|f|}{\sqrt{2\pi}} e^{-\frac{(\tau-t)^2 f^2}{2}} e^{-j2\pi f t} dt \quad (2)$$

$$g(t) = \frac{1}{\sigma\sqrt{2\pi}} e^{-\frac{t^2}{2\sigma^2}} \quad (3)$$

$$\sigma(f) = \frac{1}{|f|} \quad (4)$$

Where $h(t)$ is the signal, t represent the time, f the frequency, $g(t)$ the scalable Gaussian window and σ is a parameter which control the position of the Gaussian window on the x-axis. When the window is wider in time domain, s-transform provides better frequency resolution for lower frequency. While the window in narrower, it provide better time resolution for higher frequency.

IV. PARAMETER ESTIMATION

Parameters of the signal are estimated from the time frequency distribution to recognize the signal information in time.

A. Instantaneous RMS Current

The instantaneous RMS current is

$$I_{RMS}[t] = \sqrt{\int_0^{f_{max}} S_x(t, f) df} \quad (5)$$

B. Instantaneous RMS Fundamental Current (I_{1rms})

Instantaneous RMS fundamental current $I_{1rms}(t)$ is defined as the RMS current at power system frequency [14] and can be calculated as:

$$I_{1RMS}(t) = \sqrt{2 \int_{f_{lo}}^{f_{hi}} S_x(t, f) df} \quad (6)$$

$$f_{hi} = f_1 + \frac{\Delta f}{2}, f_{lo} = f_1 - \frac{\Delta f}{2}$$

Where f_1 is the fundamental frequency that corresponds to the power system frequency and Δf is the bandwidth which is set to 50Hz.

C. Total Harmonic Distortion (THD)

THD is the relative signal energy present at non-fundamental frequencies and written as:

$$I_{THD}(t) = \frac{\sqrt{\sum_{h=2}^H I_{h,RMS}(t)^2}}{I_{1RMS}(t)} \quad (7)$$

Where $I_{h,RMS}(t)$ is RMS harmonic current and H is the highest measured harmonic component.

D. Total nonHarmonic Distortion (TnHD)

Nonharmonics are not multiple integer signal components frequency of the power system frequency. Therefore, TnHD is referred as distinguishing between nonharmonic and noise, and is calculated as:

$$I_{TnHD}(t) = \frac{\sqrt{\sum_m^M I_{m,RMS}(t)^2}}{I_{1RMS}(t)} \quad (8)$$

Where $I_{m,RMS}(t)$ is instantaneous RMS nonharmonic current and M is the highest measured nonharmonic component.

E. Total Waveform Distortion (TWD)

TWD consists of harmonic distortion and nonharmonic distortion. It can define as:

$$I_{TWD}(t) = \sqrt{I_{THD}(t)^2 + I_{TnHD}(t)^2} \quad (9)$$

V. RESULTS

Results were analyzed using computer generated waveform using MATLAB obtained from both time-frequency distributions to determine their accuracy. Then, leakage current pattern are analyzed using spectrogram and s-transform.

A. Performance comparison analysis

Fig. 2a shows the simulated signal consist of fundamental frequency 50Hz and 20th harmonic that is 1000Hz then the harmonic happen for 0.2s that is for 10 cycles. Fig. 2b irms in pu for spectrogram and Fig. 2c irms pu for s-transform. It clearly shows that the resolution of s-transform is higher than spectrogram based on the magnitudes of irms.

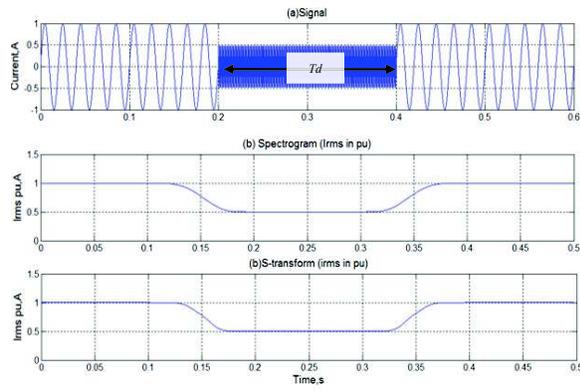


Figure 2. IRMS value of spectrogram and s-transform

Fig. 2a shows the signal with 1000Hz and the duration measurements, T_d have been varies in 0.2s until 0.4s to observe the accuracy of the time for both methods. The results show in Fig. 3 point out s-transform values closer to actual time than spectrogram. This indicates that s-transform is more accurate.

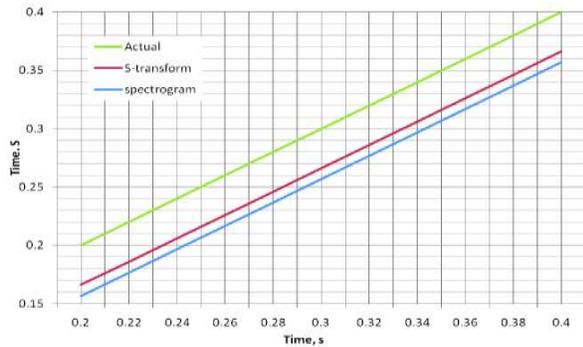


Figure 3. Duration measurements for different T_d

Fig. 4a shows signal that contain harmonic and non-harmonic in time domain. The signal hold fundamental, harmonic 50 Hz, 350 Hz and 455 Hz which have different amplitudes that is 1A, 0.5A and 0.3A significantly. Fig. 4b shows the signal in spectrogram meanwhile Fig. 4c shows the s-transform for the signal.

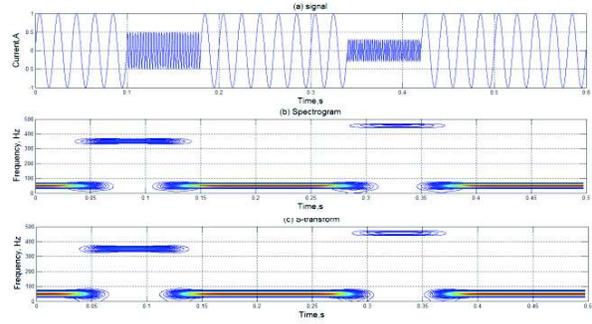


Figure 4. Spectrogram and s-transform for a signal with different frequencies

From Fig. 4 the information extracted that is THD and TnHD from both methods shown in Fig. 5a and Fig. 5b.

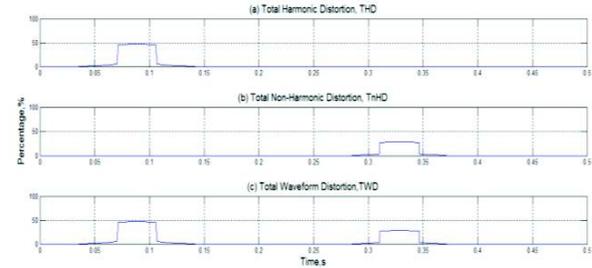


Figure 5a. THD, TnHD and TWD from Spectrogram

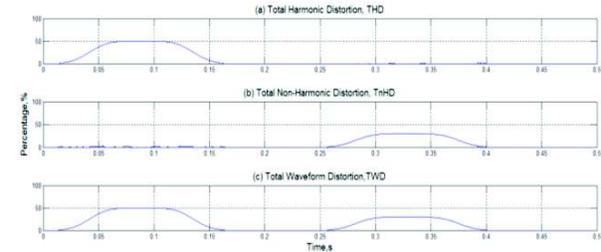


Figure 5b. THD, TnHD and TWD from s-transform

Optimal technique can be determine by comparing the accuracy of both methods. In order to attain accuracy of the simulation result, mean absolute percentage error (MAPE) was used as index. Smaller value of MAPE indicates more accurate results. It have been tested in [15]. The equation for mean absolute percentage error (MAPE) is shown below. Where A_t is actual value, F_t is measured value and n is number of data.

$$MAPE = \frac{100\%}{n} \sum_{t=1}^n \left| \frac{A_t - F_t}{A_t} \right| \quad (10)$$

The MAPE value for Fig. 3 was calculated. The spectrogram MAPE result is 1.1811% and s-transform is 1.5095%. The MAPE results prove that s-transform gives the smaller value than spectrogram.

B. Leakage current analysis

The leakage current signals consist of several patterns that are capacitive, resistive, symmetrical discharge and unsymmetrical discharge. Fig. 6, 7, 8, 9 shows the

parameter estimation obtains from spectrogram and s-transform for each leakage current patterns.

The amplitudes of IRMS have been normalized by dividing by the RMS value of the normal signal (resistive signal) over the window being analyzed. This is because at resistive signal only fundamental frequency, 50Hz exist. This information can be used to identify the surface condition of insulator.

In capacitive state, the IRMS value for spectrogram is higher than s-transform shown in Fig. 6b. Then, the other parameters only have slightly difference for each other.

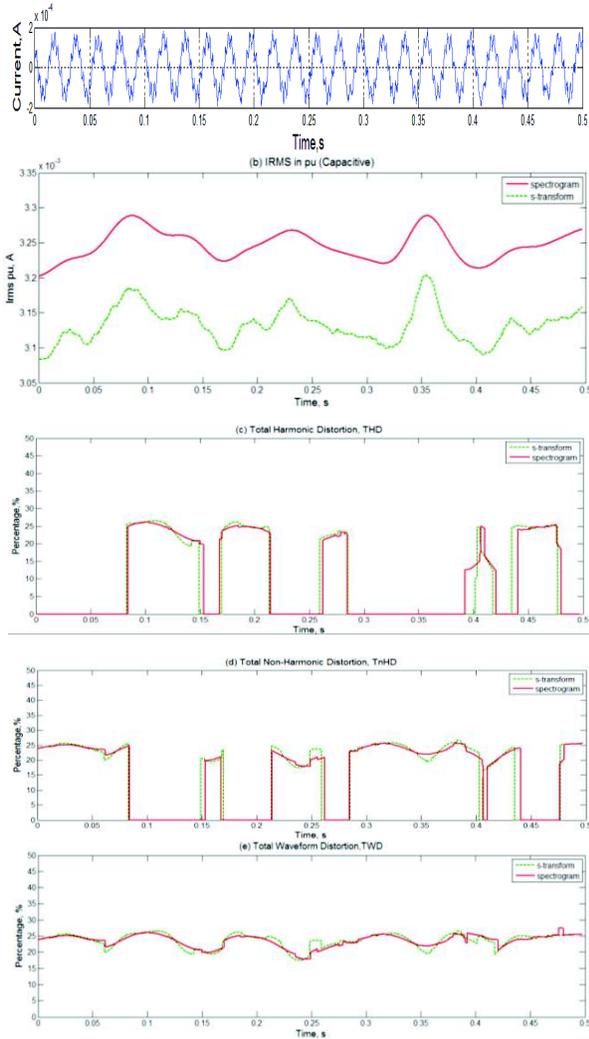


Figure 6. (a) Capacitive signal (b) I rms in pu (c) THD (d) TnHD (e) TWD

In resistive state, the IRMS value for spectrogram is higher than s-transform but for other parameters both show zero percent.

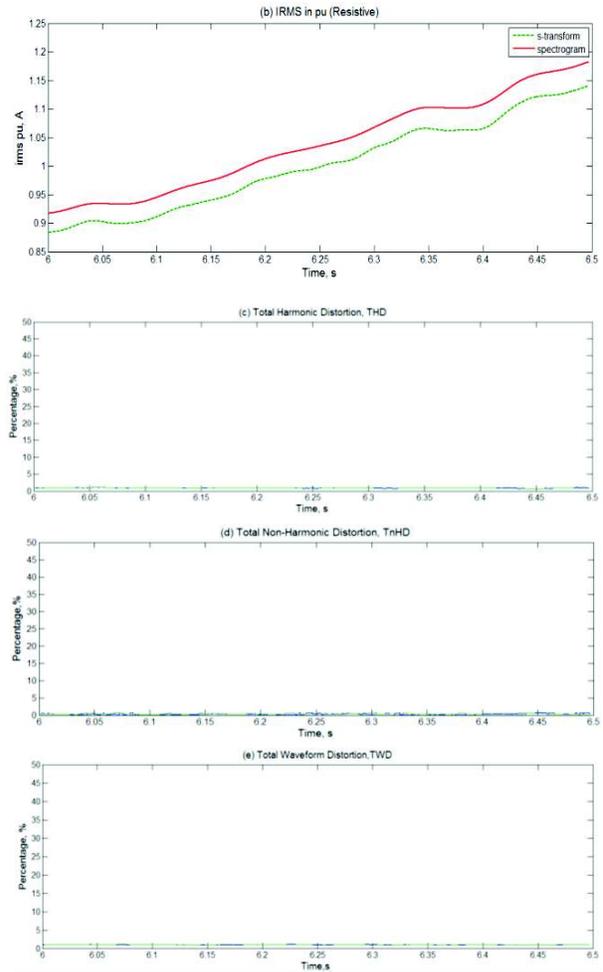
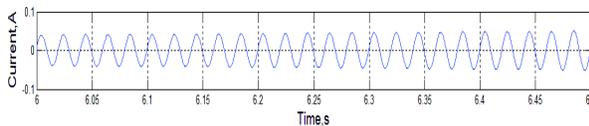
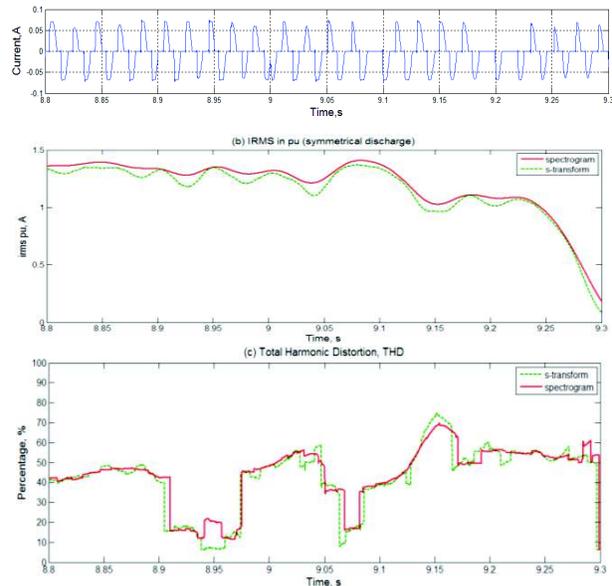


Figure 7. (a) Resistive signal (b) I rms in pu (c) THD (d) TnHD (e) TWD

In symmetrical discharge state, there are only small differences for all the parameter.



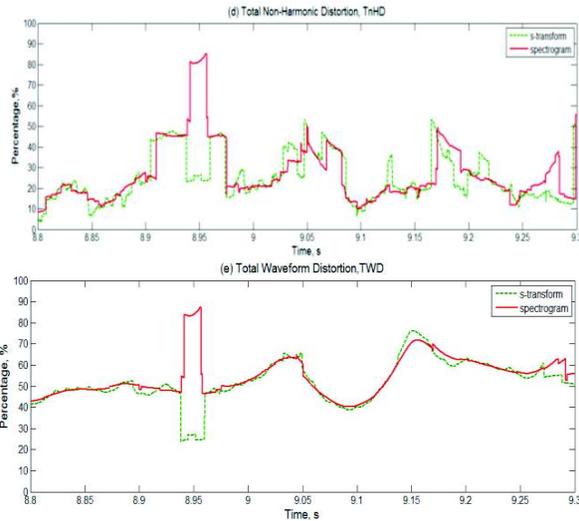


Figure 8. (a) Symmetrical signal (b) Irms in pu (c) THD (d) TnHD (e) TWD

In unsymmetrical discharge state, there are significant differences at THD, TnHD and TWD values. The values for IRMS only have small differences from each others.

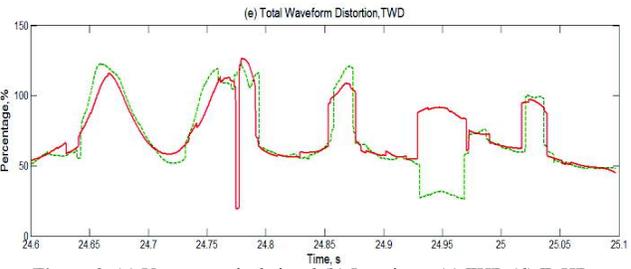
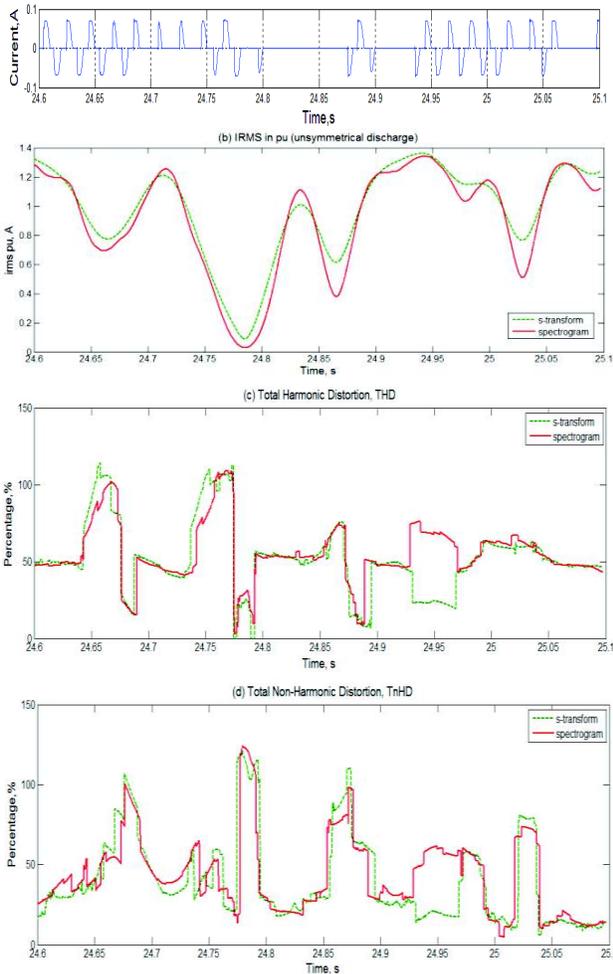


Figure 9. (a) Unsymmetrical signal (b) Irms in pu (c) THD (d) TnHD (e) TWD

VI. CONCLUSION

The instantaneously estimated parameters such as Irms, THD, TnHD, and TWD help monitoring state condition of the materials insulating condition. Spectrogram and s-transform in time representation present information on frequency component with respect to time, frequency, and magnitude. The frequency component is consisting not only harmonics but also inter harmonic. Frequency component level of the signal can be used as indicator of surface condition event. Also, with higher content of harmonic and inter-harmonic will demonstrate the severity of the LC signal distortion. The information obtains from s-transform quite similar with spectrogram but it has better time information than spectrogram based on MAPE analysis. S-transform is useful for classification to determine the insulator surface condition.

ACKNOWLEDGMENT

The authors gratefully acknowledge the Faculty of Electrical Engineering, Universiti Teknikal Malaysia Melaka for giving the support in this study.

REFERENCES

- [1] J. Mackevich and M. Shah, "Polymer outdoor insulating materials Part I: Comparison of porcelain and polymer electrical insulation," *IEEE Electrical Insulation Magazine*, vol. 13, pp. 5-12, 1997.
- [2] P. K. Dash, B. K. Panigrahi, and G. Panda, "Power quality analysis using S-transform," *Power Delivery, IEEE Transactions on*, vol. 18, pp. 406-411, 2003.
- [3] I. W. C. Lee and P. K. Dash, "S-transform-based intelligent system for classification of power quality disturbance signals," *Industrial Electronics, IEEE Transactions on*, vol. 50, pp. 800-805, 2003.
- [4] Z. Fengzhan and Y. Rengang, "Power-Quality Disturbance Recognition Using S-Transform," *Power Delivery, IEEE Transactions on*, vol. 22, pp. 944-950, 2007.
- [5] Z. Leonowicz, T. Lobos, and K. Wozniak, "Analysis of non-stationary electric signals using the S-transform," *COMPEL: The International Journal for Computation and Mathematics in Electrical and Electronic Engineering*, vol. Vol. 28, pp. pp.204 - 210, 2009.
- [6] M. H. J. Bollen and I. Y.-H. Gu, in *Signal Processing of Power Quality Disturbances*, ed: John Wiley & Sons, Inc., 2005.
- [7] E. Al-Ammar and G. G. Karady, "Transfer function analysis using STFT for improvement of the fault detection sensitivity in transformer impulse test," in *Power Engineering Society General Meeting, 2005. IEEE*, 2005, pp. 1855-1862 Vol. 2.
- [8] S. Zhang, L. Ruirui, Q. Wang, J. T. Heptol, and G. Yang, "The research of power quality analysis based on improved S-Transform," in *Electronic Measurement & Instruments, 2009*.

- ICEMI '09. 9th International Conference on*, 2009, pp. 2-477-2-481.
- [9] M. A. R. M. Fernando and S. M. Gubanski, "Leakage current patterns on contaminated polymeric surfaces," *IEEE Transactions on Dielectrics and Electrical Insulation*, vol. 6, pp. 688-694, 1999.
- [10] H. I. S. Jayasundara, W. P. S. Sudarshani, and M. A. R. M. Fernando, "Leakage Current Patterns on High Voltage Insulators: Analysis on Frequency and Time-frequency Domains," in *Industrial and Information Systems, 2008. ICIIS 2008. IEEE Region 10 and the Third international Conference on*, 2008, pp. 1-6.
- [11] N. Q. Z. Abidin, A. R. Abdullah, N. Norddin, A. Aman, and K. A. Ibrahim, "Leakage current analysis on polymeric surface condition using time-frequency distribution," in *Power Engineering and Optimization Conference (PEOCO), 2012 IEEE International*, 2012, pp. 171-175.
- [12] A. Aman and M. M. Yaacob, "Classification of Polymeric Insulating Surface Condition Based on Leakage Current Total Waveform Distortion " *Archives Des Sciences*, vol. Vol 65, No. 9, 2012.
- [13] R. G. Stockwell, L. Mansinha, and R. P. Lowe, "Localization of the complex spectrum: the S transform," *Signal Processing, IEEE Transactions on*, vol. 44, pp. 998-1001, 1996.
- [14] A. Kusko and M. T. Thompson, *Power Quality in Electrical Systems*: McGraw Hill, 2007.
- [15] A. R. Abdullah and A. Z. Sha'ameri, "Power quality analysis using linear time-frequency distribution," in *Power and Energy Conference, 2008. PECon 2008. IEEE 2nd International*, 2008, pp. 313-317.